


CITY OF ONEIDA TYPICAL SERVICE

NOTE: THE CURB STOP SHALL BE TURNED ON BY THE WATER DEPARTMENT AFTER THE METER INSTALLATION HAS BEEN INSPECTED AND APPROVED.

WARNING
BEFORE YOU DIG CALL U.F.P.D. 1-800-962-7962
IT'S THE LAW

CALL THE WATER DEPARTMENT @
363-1490 PRIOR TO BACKFILLING

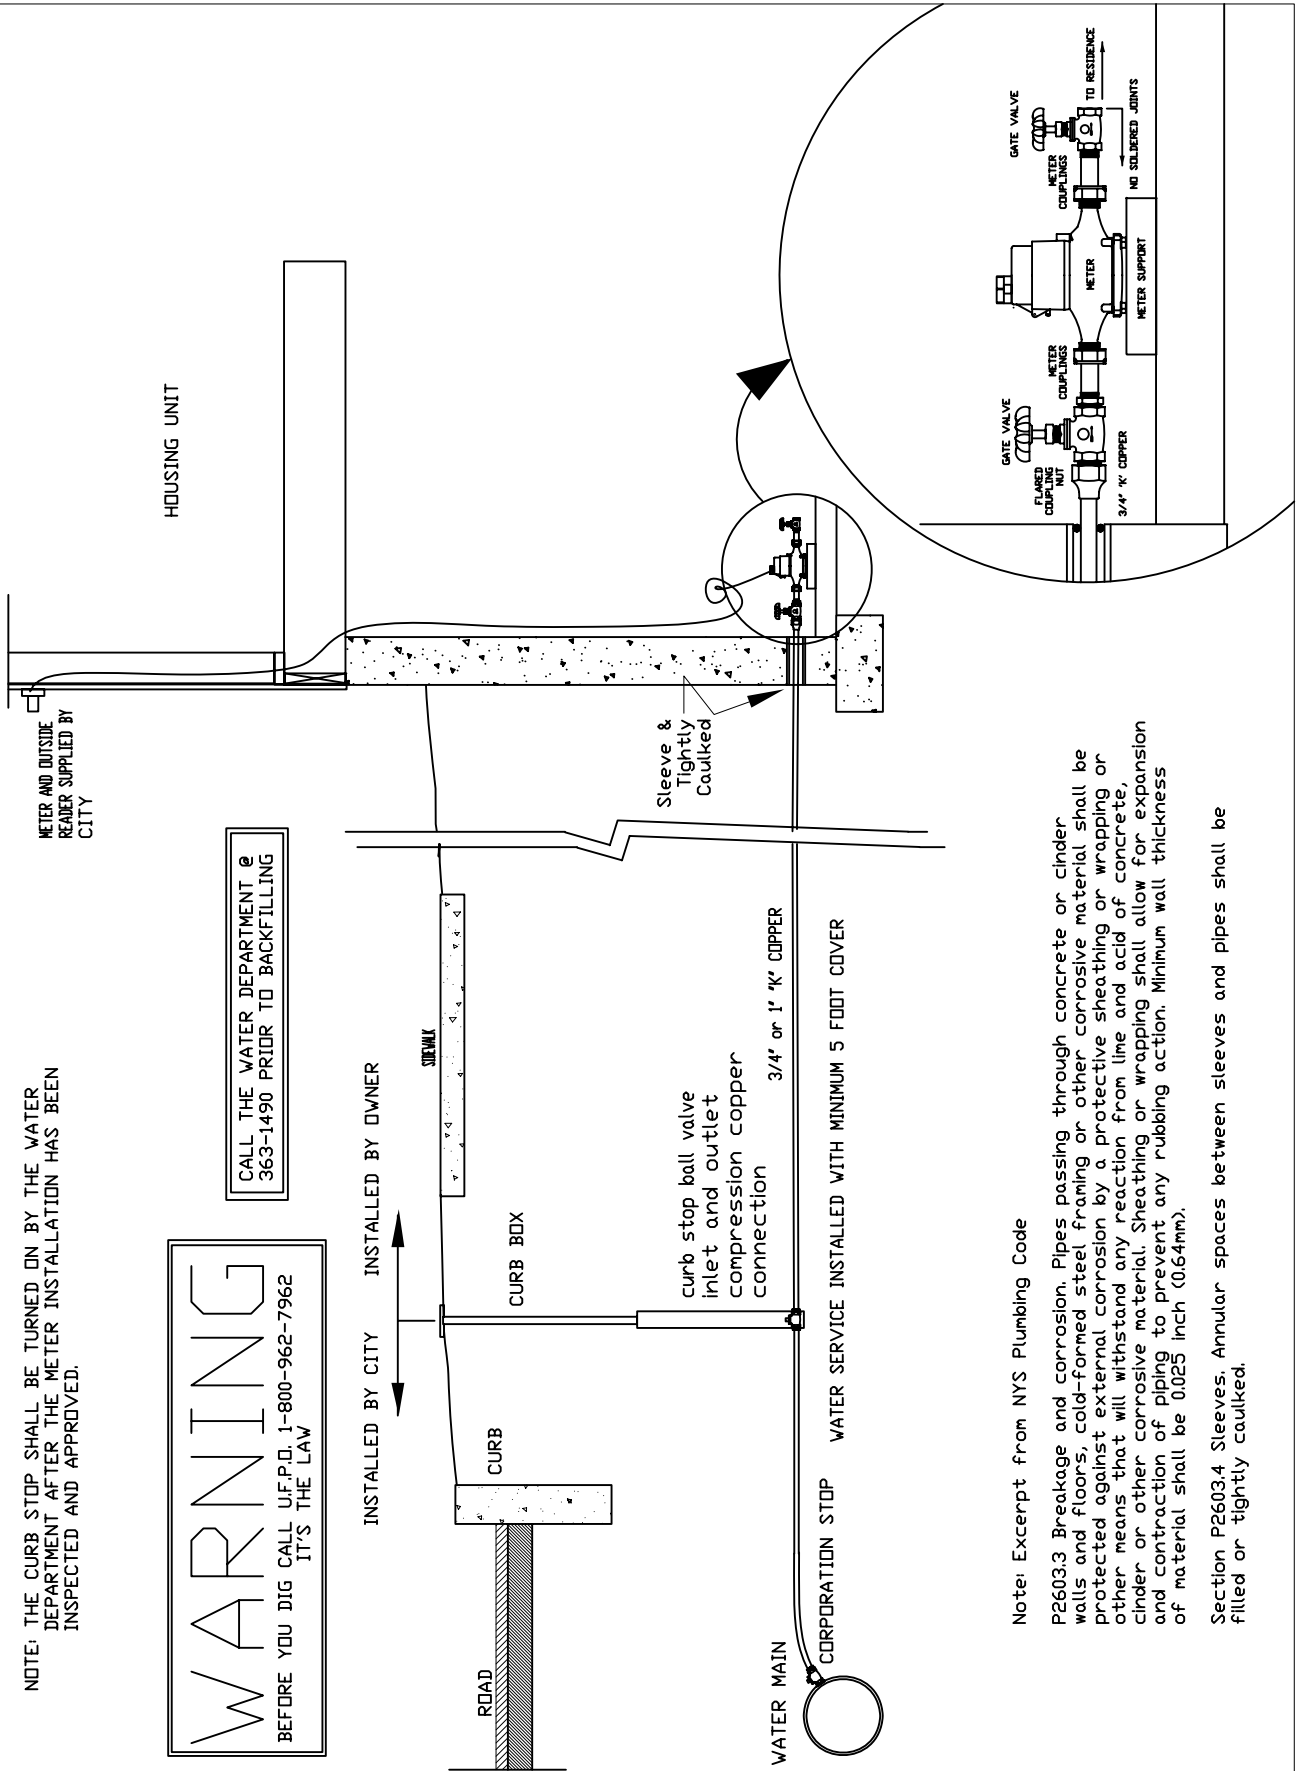

Note: Excerpt from NYS Plumbing Code

P2603.3 Breakage and corrosion. Pipes passing through concrete or cinder walls and floors, cold-formed steel framing or other corrosive material shall be protected against external corrosion by a protective sheathing or wrapping or other means that will withstand any reaction from lime and acid of concrete, cinder or other corrosive material. Sheathing or wrapping shall allow for expansion and contraction of piping to prevent any rubbing action. Minimum wall thickness of material shall be 0.025 inch (0.64mm).

Section P2603.4 Sleeves. Annular spaces between sleeves and pipes shall be filled or tightly caulked.

Oneida Water Department
PO Box 550
109 North Main Street
Oneida NY 13421

VOICE: (315) 363-1490
FAX: (315) 363-9558

APPROVED BY:

Drawn By: Arthur Smolinski

Typical Water Service

NO SCALE

DWG. NO.